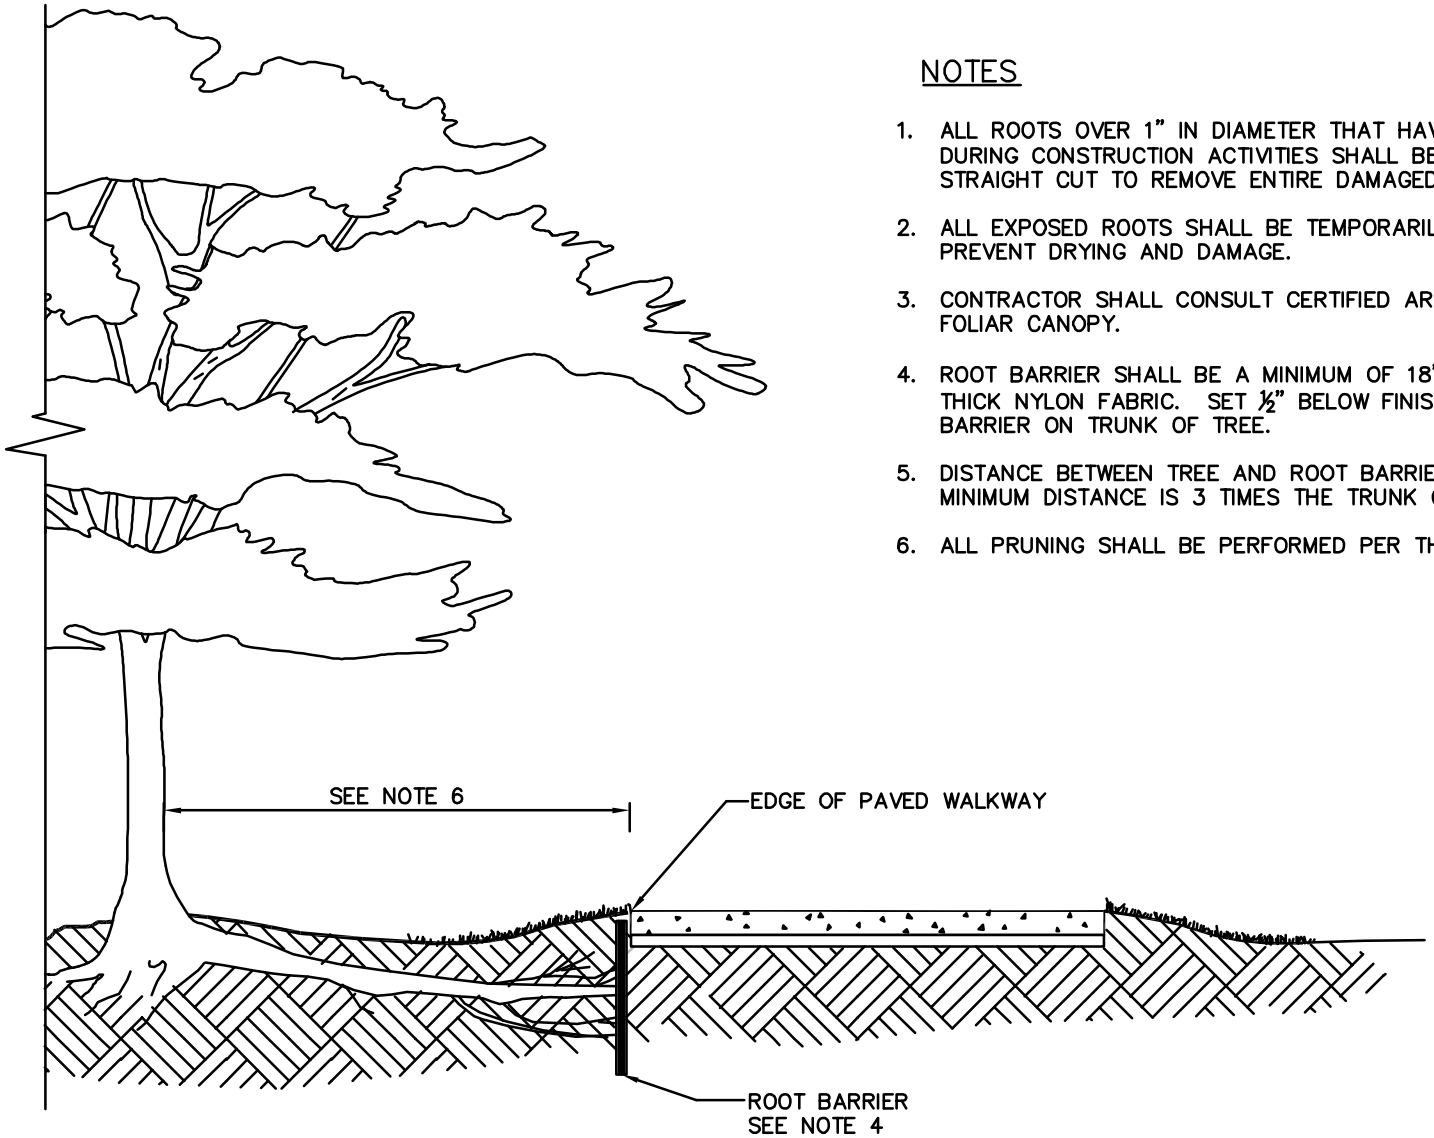

NOTES

1. ALL ROOTS OVER 1" IN DIAMETER THAT HAVE BEEN EXPOSED AND DAMAGED DURING CONSTRUCTION ACTIVITIES SHALL BE REMOVED. MAKE A CLEAN, STRAIGHT CUT TO REMOVE ENTIRE DAMAGED PORTION OF ROOT.
2. ALL EXPOSED ROOTS SHALL BE TEMPORARILY COVERED WITH DAMP BURLAP TO PREVENT DRYING AND DAMAGE.
3. CONTRACTOR SHALL CONSULT CERTIFIED ARBORIST REGARDING THINNING OF FOLIAR CANOPY.
4. ROOT BARRIER SHALL BE A MINIMUM OF 18" DEEP AND SHALL BE MADE OF ¼" THICK NYLON FABRIC. SET ½" BELOW FINISHED GRADE. CENTER ROOT BARRIER ON TRUNK OF TREE.
5. DISTANCE BETWEEN TREE AND ROOT BARRIER TO BE DETERMINED BY ENGINEER. MINIMUM DISTANCE IS 3 TIMES THE TRUNK CALIPER.
6. ALL PRUNING SHALL BE PERFORMED PER THE STANDARDS OF ANSI A300.

City of Bellevue

ROOT BARRIER FOR CONCRETE/PAVED WALKWAY

DRAWING NUMBER	DEV-15
SCALE	NONE
REVISION DATE	01/14
DEPARTMENT	TRANS