



# PLAN – RAIN GARDEN OVERFLOW WITH CONVEYANCE FURROW

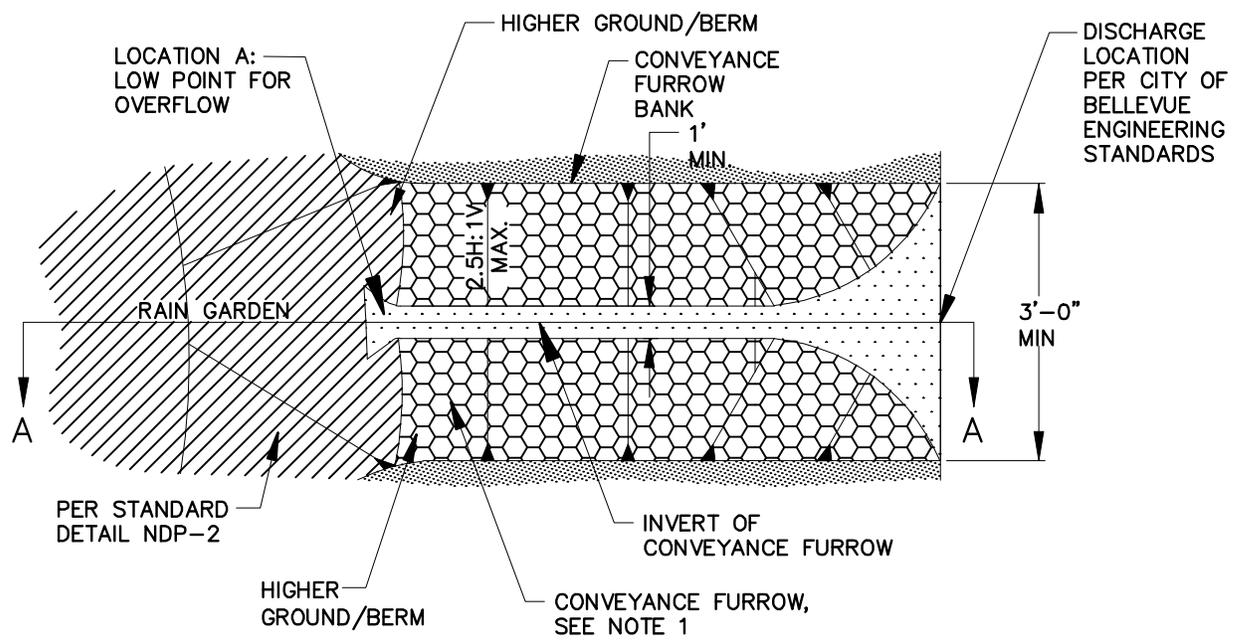

# SECTION A – RAIN GARDEN OVERFLOW WITH CONVEYANCE FURROW

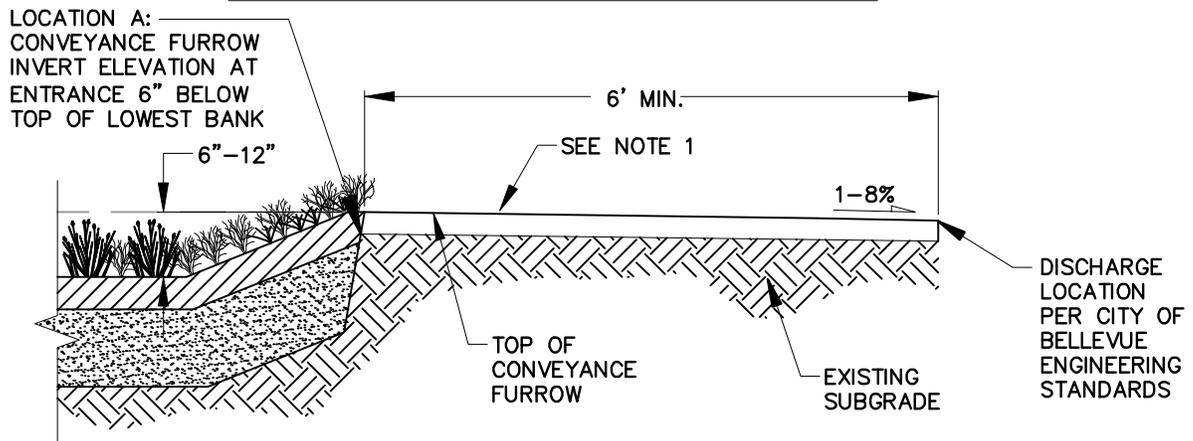

**NOTE:**

1. LINE CONVEYANCE FURROW WITH STREAMBED COBBLE PER STANDARD SPECIFICATIONS 9-03.11(2) (MIN 6" DEPTH) FOR DESIGN FLOW UP TO 4 F.P.S., OR MIN. 12" BIORETENTION SOIL MIX FOR DESIGN FLOW LESS THAN 4 F.P.S. AND PLANT WITH BIORETENTION GROUND COVERS OR TURF, OR PER ENGINEER'S DESIGN.

	<h2 style="margin: 0;">City of Bellevue</h2>	<p style="margin: 0;">STORM AND SURFACE WATER UTILITY</p>
<p style="margin: 0;">TITLE</p> <p style="margin: 0;">RAIN GARDEN OVERFLOW WITH CONVEYANCE FURROW</p>		<p style="margin: 0;">NO. NDP-6</p>