




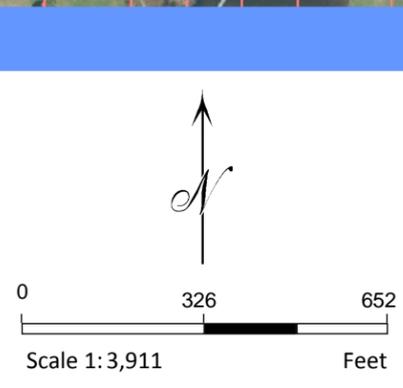

- City Parks
- Parcels

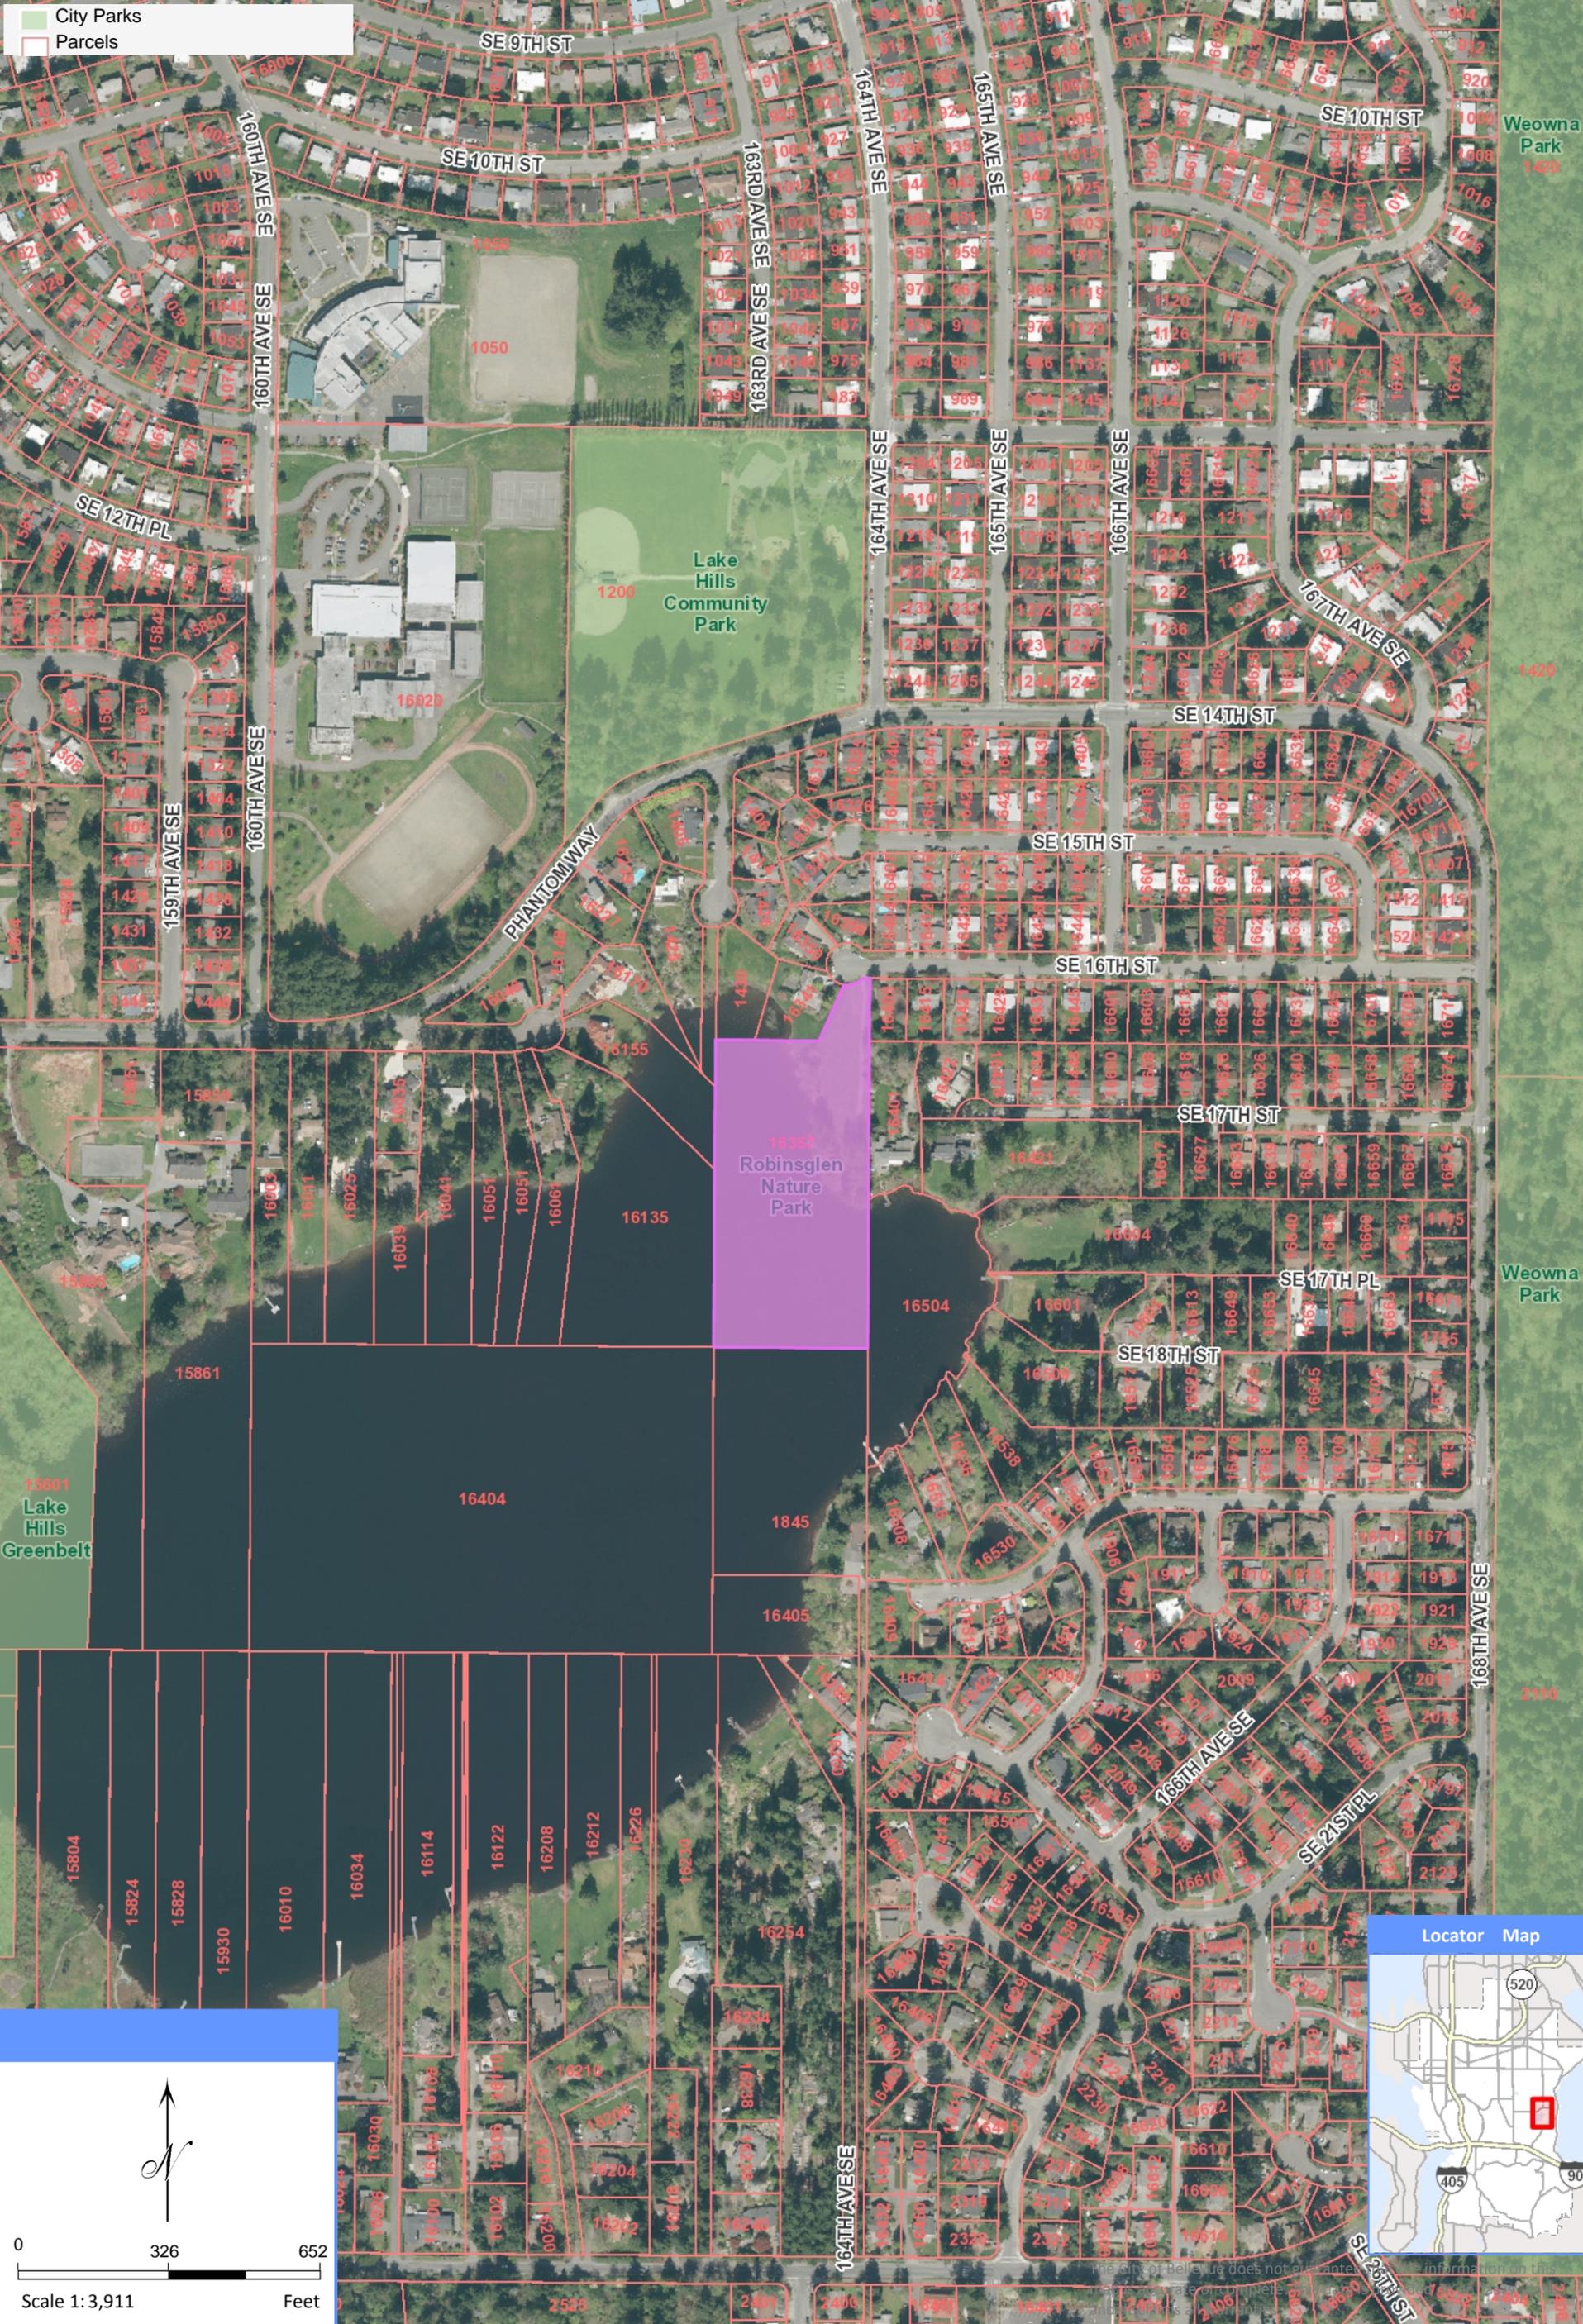


- CONSTRUCTION NOTES:**
- 1 PROVIDE HOUSEKEEPING PAD AS CLOSE TO EXISTING ROCKERY AS POSSIBLE.
 - 2 DE-ENERGIZE, DISCONNECT AND CAREFULLY DETACH EXISTING GENERATOR RECEPTACLE AND RELOCATE AT NEW GENERATOR CONNECTION PEDESTAL.
 - 3 INTERCEPT AND EXTEND THE EXISTING MTS CONDUIT AND WIRE. PROVIDE A 2" PVC SCHEDULE 80 CONDUIT WITH 4#2, #8 GND TO THE NEW GENERATOR RECEPTACLE PEDESTAL.

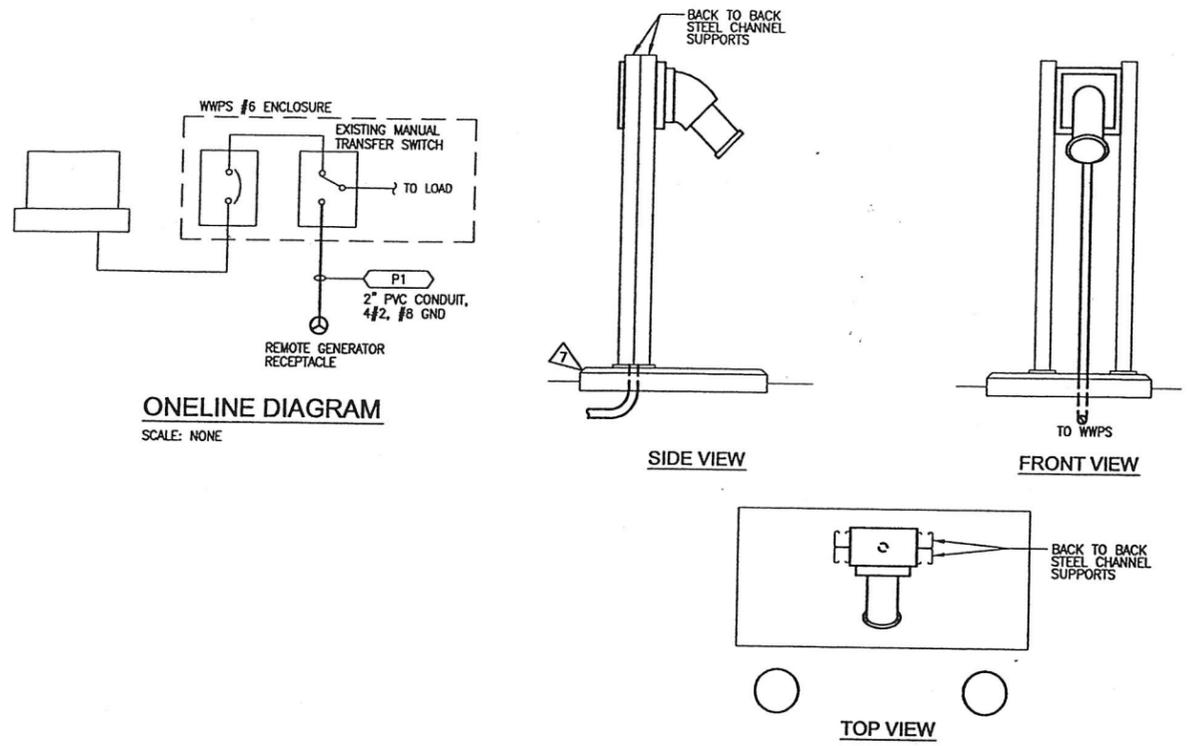

ONELINE DIAGRAM
 SCALE: NONE

GENERATOR RECEPTACLE MOUNTING DETAILS
 SCALE: NONE

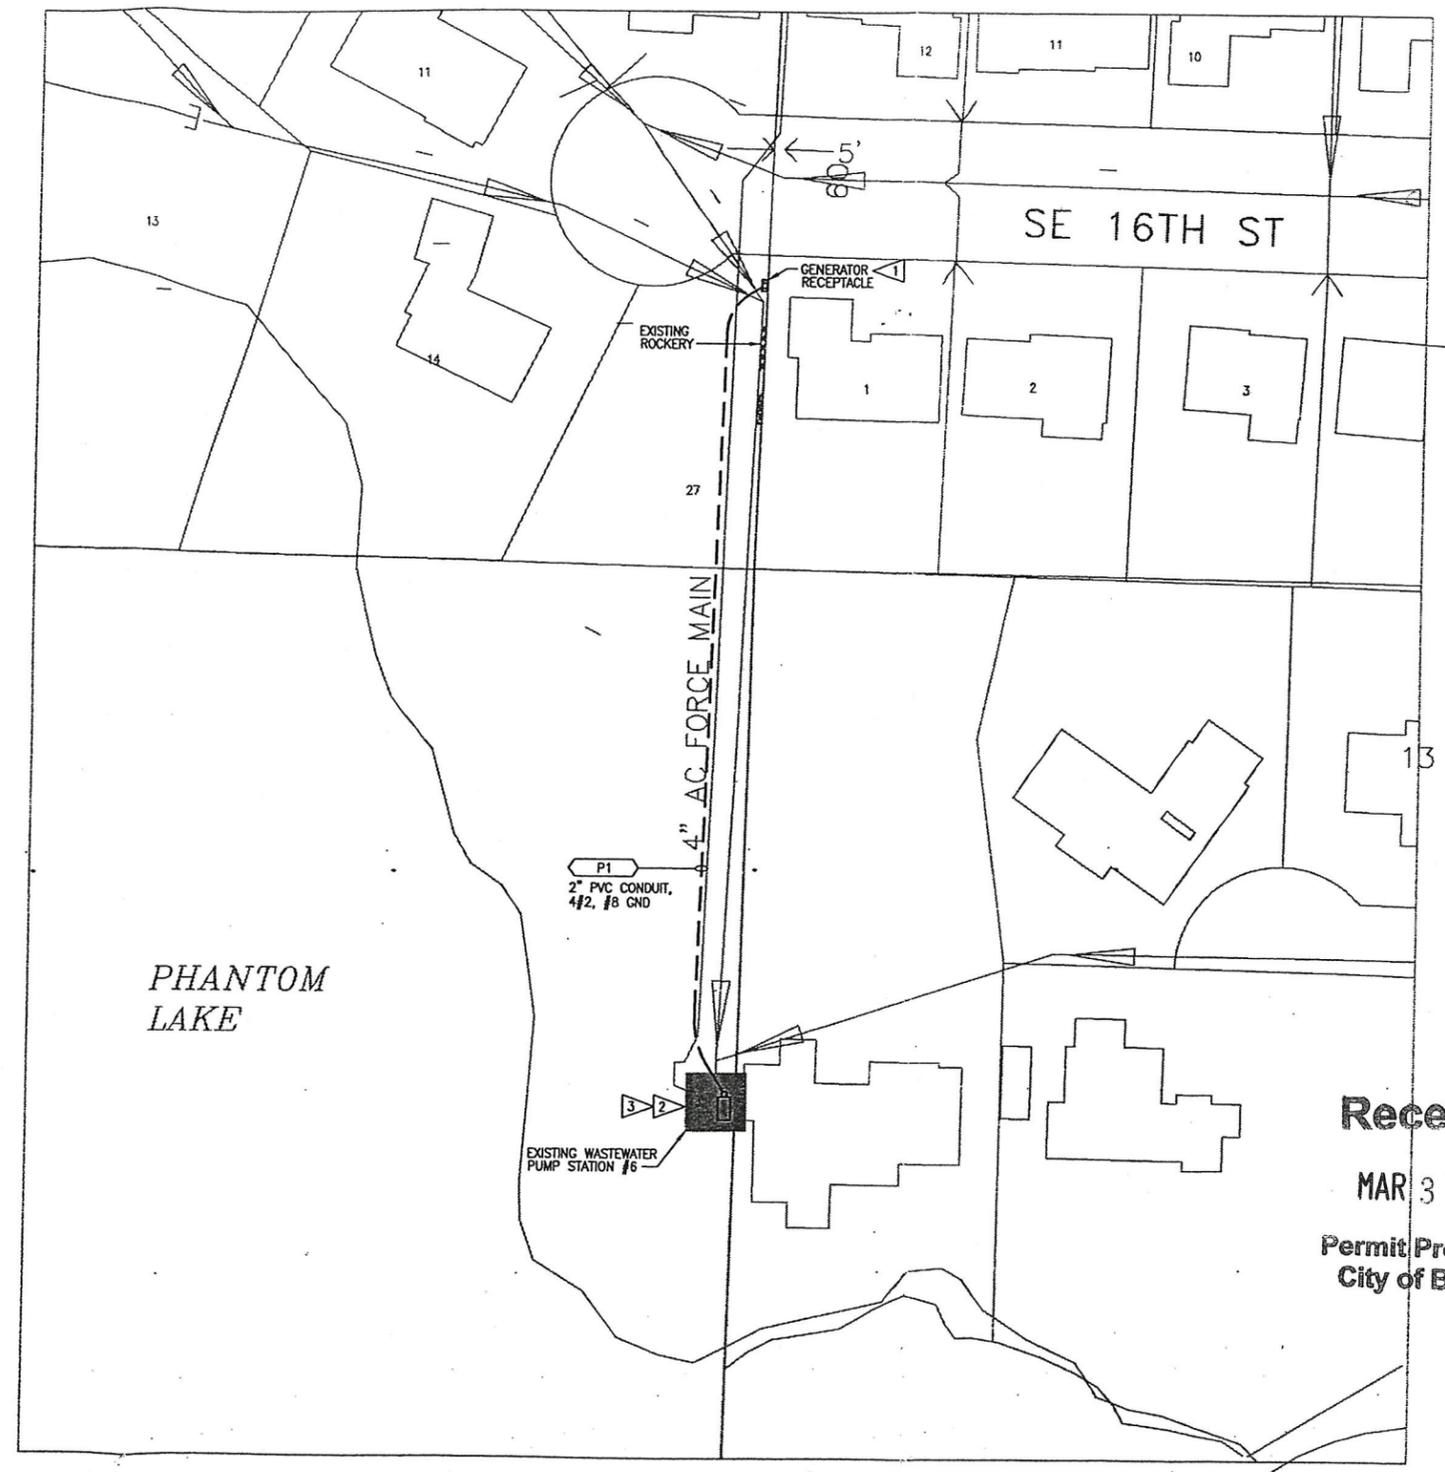


Received
 MAR 31 2014
 Permit Processing
 City of Bellevue

NO	DATE	BY	APPR	REVISIONS

CASNE ENGINEERING, INC.
 ELECTRICAL AND TECHNOLOGY CONSULTANTS
 10804 NE 38th PL., SUITE 205 12730 E. MARIBEAU PKWY, SUITE 300
 KIRKLAND, WA 98033 SPokane Valley, WA 99216
 PHONE: (425) 522-1000 PHONE: (509) 522-7887

Approved By

DESIGN MANAGER	DATE	D. LINDSEY	DATE
PROJECT MANAGER	DATE	R. FARLEY	DATE
		K. ALBINGER	DATE
		CHECKED BY	DATE

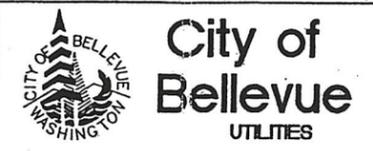

WWPS #6 RECEPTACLE REPLACEMENT
 ONE AND FIVE LINE
 DIAGRAM