

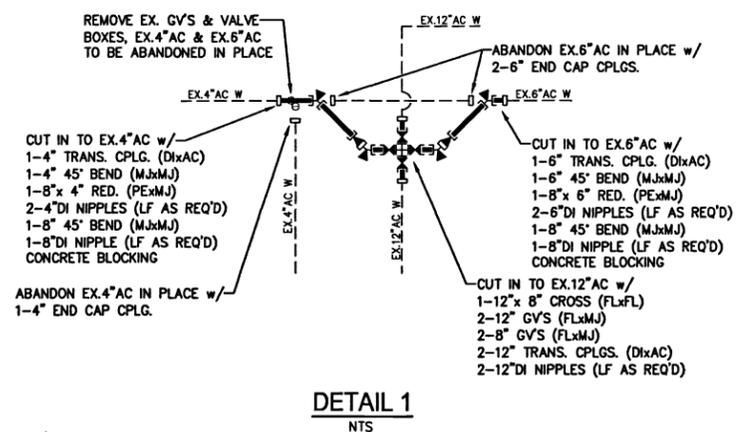


FILE NAME: F:\0023\0000\0000\DESIGN\DWG\PHASE 2\12-001-SITE 12  
 VERSION: 2003  
 USER: HECOX  
 PLOTTING DATE: 11/20/07

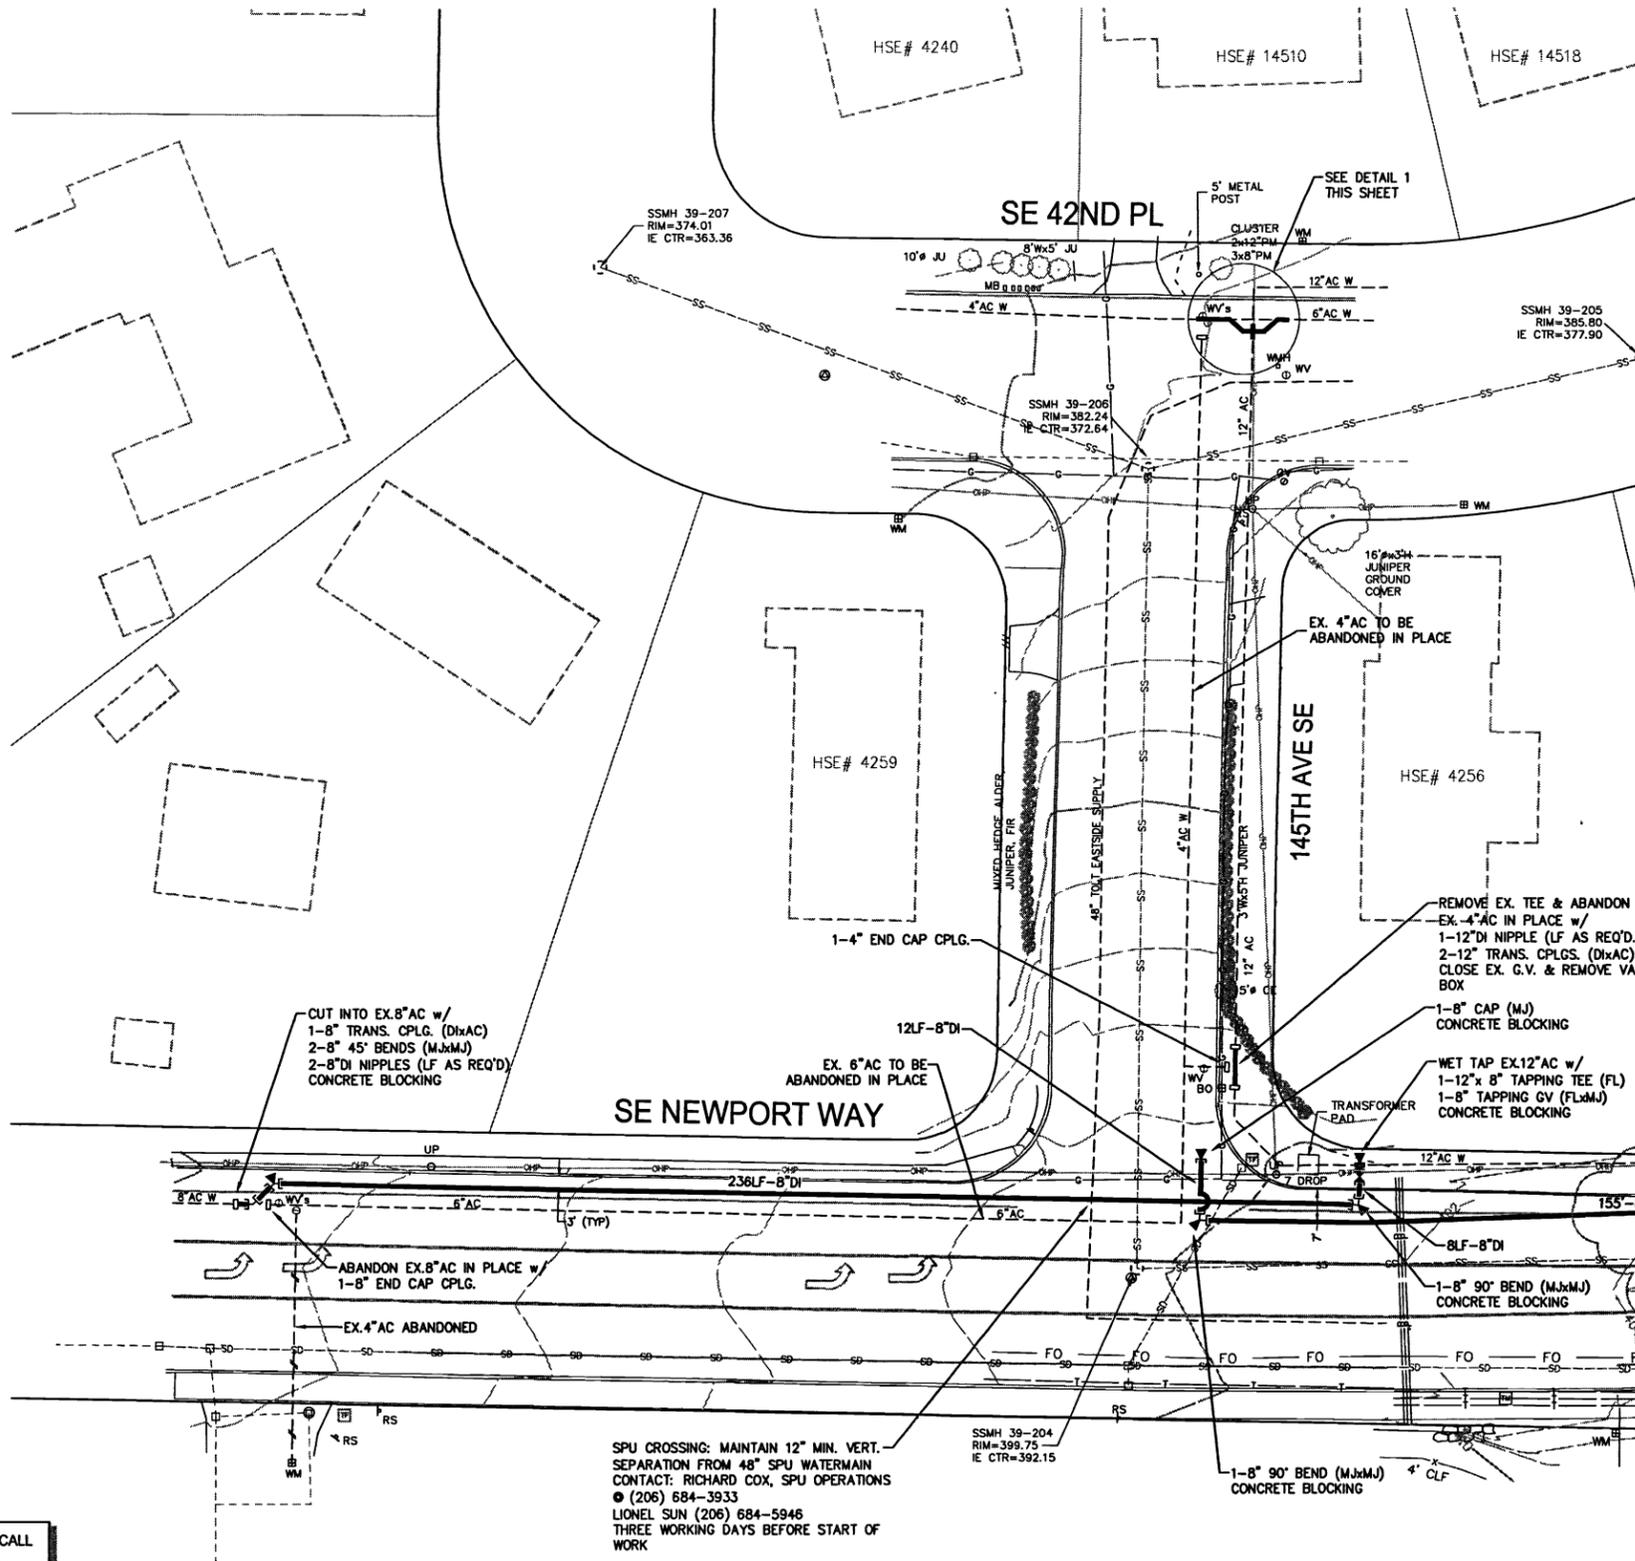

- WATER SERVICE CONSTRUCTION NOTES**
- EXISTING SUBSTANDARD SERVICE LINES SHALL BE REPLACED WITH 1-INCH, TYPE K COPPER SERVICE LINE. CRIMP OR CAP EXISTING SERVICE LINE AND ABANDON IN PLACE.
  - REMOVE AND DISPOSE OF EXISTING SETTER, FURNISH AND INSTALL NEW 1-INCH SETTER PER STANDARD DETAIL NO. W-23, ITEM E WITH ADAPTERS FOR 3/4" WATER METER. CONNECT SETTER TO WATER SERVICE LINE AND CUSTOMER SERVICE LINE.
  - REMOVE AND DISPOSE OF EXISTING WATER METER BOX, FURNISH AND INSTALL NEW MID STATES PLASTIC MODEL MSBCF 1324-12 BOX.
  - INSTALL 3/4" METER SUPPLIED BY THE CITY OF BELLEVUE. RETURN EXISTING METER TO THE CITY.
  - RE-INSTALL EXISTING METER.
  - REMOVE AND DISPOSE OF EXISTING SETTER, FURNISH AND INSTALL NEW 1-INCH, SETTER PER STANDARD DETAIL. CONNECT SETTER TO WATER SERVICE LINE AND CUSTOMER SERVICE LINE.
  - RECONNECT TO WATER MAIN (LONG/SHORT). EXISTING COPPER WATER SERVICE LINE SHALL BE RECONNECTED TO THE WATER MAIN. SHORT SIDE WATER SERVICES ARE THOSE WHERE THE NEW WATER MAIN IS LOCATED BETWEEN THE WATER METER AND THE OLD WATER MAIN TO BE ABANDONED. LONG SIDE WATER SERVICES ARE THOSE WHERE THE OLD MAIN TO BE ABANDONED IS LOCATED BETWEEN THE WATER METER AND THE NEW WATER MAIN.

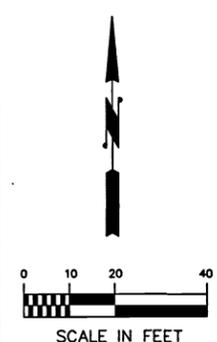

**BURIED UTILITIES IN AREA CALL TWO BUSINESS DAYS BEFORE YOU DIG**  
 1-800-424-5555  
 EXISTING UTILITIES SHOWN ARE FROM THE BEST AVAILABLE INFORMATION AND NO GUARANTEE IS MADE AS TO THE EXACT SIZE, TYPE, LOCATION OR DEPTH.

SPU CROSSING: MAINTAIN 12" MIN. VERT. SEPARATION FROM 48" SPU WATERMAIN  
 CONTACT: RICHARD COX, SPU OPERATIONS  
 (206) 684-3933  
 LIONEL SUN (206) 684-5946  
 THREE WORKING DAYS BEFORE START OF WORK



THIS DRAWING REDUCED ONE-HALF (SCALE ACCORDINGLY)

NO	DATE	BY	APPR	REVISIONS
1	11/20/07	DSH	JFH	REVISION PER C.O.B.

Roth Hill Engineering Partners, LLC  
 2800 116th Avenue NE #100  
 Bellevue, Washington 98004  
 Tel 425.869.9448  
 Fax 425.869.1190

Approved By	
DESIGN/CONSTRUCTION MANAGER	DATE
DESIGN SUPERVISOR	DATE
PROJECT MANAGER	DATE

JAY GIBSON  
 DESIGNED BY  
 STEVE HECOX/PAVEL LURIE  
 DRAWN BY  
 LAURIE FULTON  
 CHECKED BY

**City of Bellevue**  
 UTILITIES

2007 AC WATERMAIN REPLACEMENT PHASE 2 C.I.P. W-16 145TH AVE SE AND SE NEWPORT WAY	
15-24-5 J-13	SHT 18 OF 23