




PLAN - CURBSIDE SIDEWALK

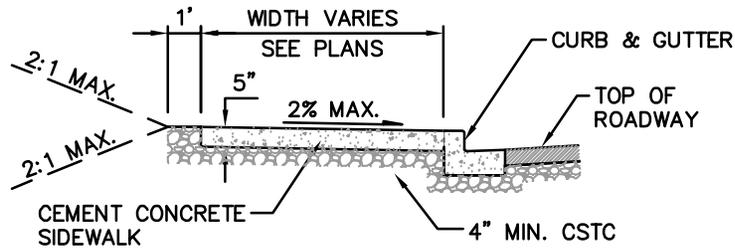


SECTION - CURBSIDE SIDEWALK

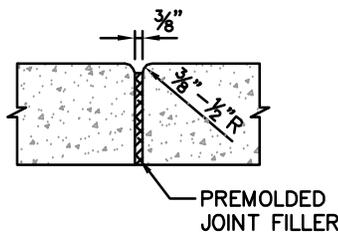


FULL DEPTH EXPANSION JOINT DETAIL



CONTRACTION JOINT DETAIL

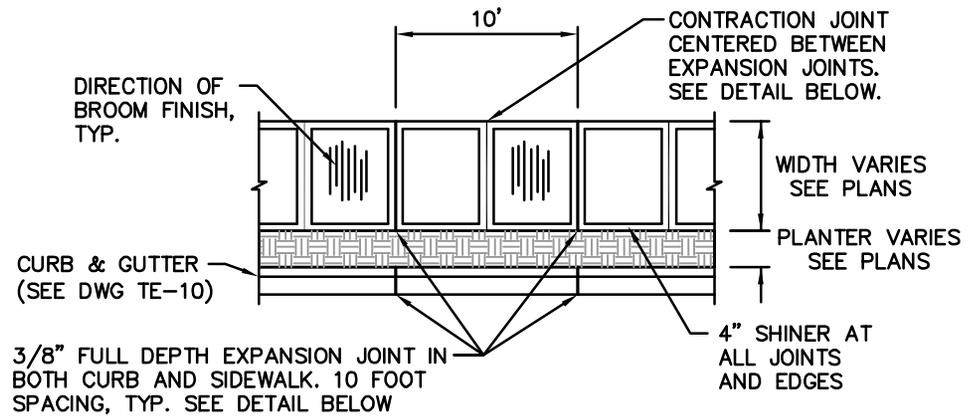

PLAN - SIDEWALK WITH PLANTER STRIP

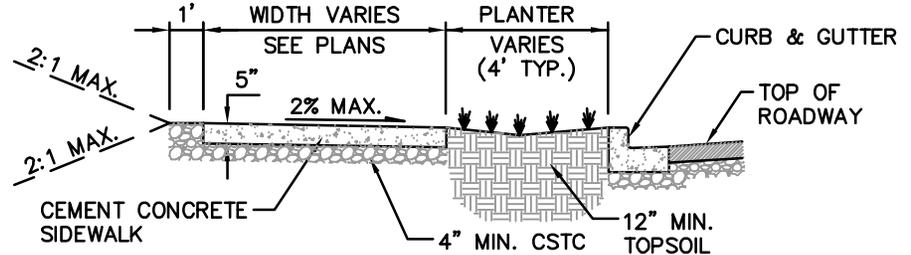

SECTION - SIDEWALK WITH PLANTER STRIP

NOTES:

1. CONCRETE SHALL BE AIR ENTRAINED CLASS 3000 PER SECTION 6-02 OF WSDOT STANDARD SPECIFICATIONS.
2. FINISH: LIGHT FINISH WITH A STIFF BROOM PERPENDICULAR TO CURB. FOR GRADES OVER 4%, FINISH WITH A STIPPLE BRUSH.
3. REMOVAL/REPLACEMENT OF CEMENT CONCRETE CURB SHALL BE FROM EXPANSION JOINT TO EXPANSION JOINT UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
4. LIDS FOR JUNCTION BOXES AND UTILITY VAULTS SHALL BE NON-SKID AS SPECIFIED BY THE ENGINEER.



SIDEWALK

DRAWING NUMBER	TE-11
SCALE	NONE
REVISION DATE	12/12
DEPARTMENT	TRANS